




## A Typical Colloid-A-Tron (CAT) Cooling Tower Installation



Walker Station, Fort Bend ISD, TX

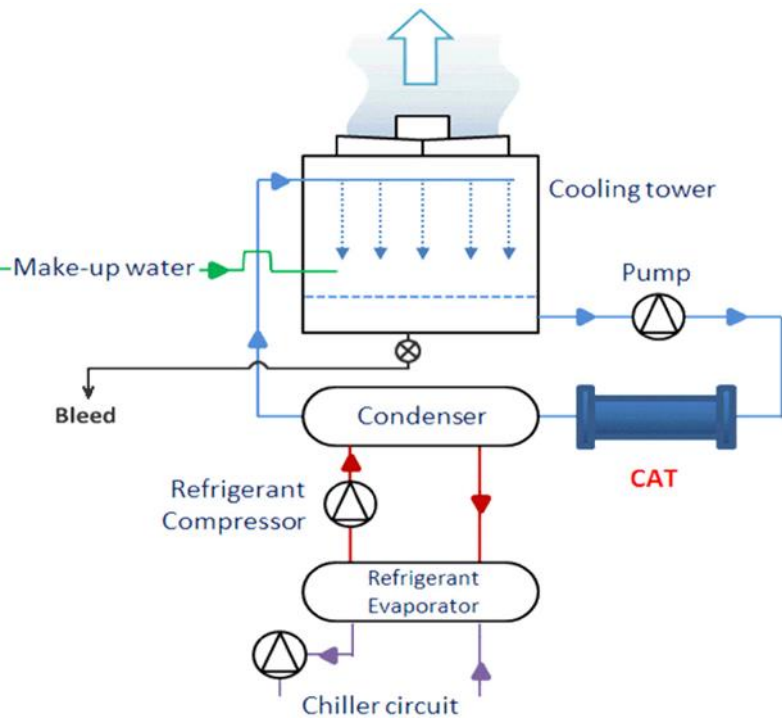